




Knox Box Requirements

Commercial – Multiple Tenants – For Buildings Equipped with a Fire Riser Room (fire sprinkler system)

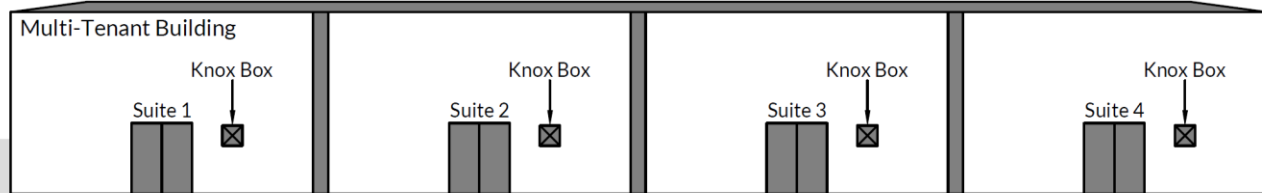

- Multi-tenant commercial buildings are required to provide a 3200 series Knox Box for each tenant space (CFC §506.1).
- Buildings equipped with a Fire Riser Room shall also provide a 3200 series Knox Box at the Fire Riser Room.
- Some buildings will require additional Knox devices.
- The “Fire Department” Alert Decal is to be mounted on the door or frame of the building’s main entrance.
- Keys to be placed into the Knox box will be determined by SFD Fire Prevention Staff (i.e. master key(s), Fire Riser Room, FACP, SDG&E, keys for appliance operation, etc.)
- Required keys shall be secured in Knox Box prior to final inspection/certificate of occupancy.
- Knox devices can be ordered and purchased at www.knoxbox.com
- Install per manufactures’ instructions.
- Minimum height = 5 ft. / Maximum height = 6 ft.

