




### Knox Box Requirements

#### Commercial - Single Tenant – For Buildings Without a Fire Riser Room (non-sprinklered)

- Non-sprinklered, single tenant commercial buildings are required to have a 3200 series Knox Box at the main entrance (CFC §506.1).

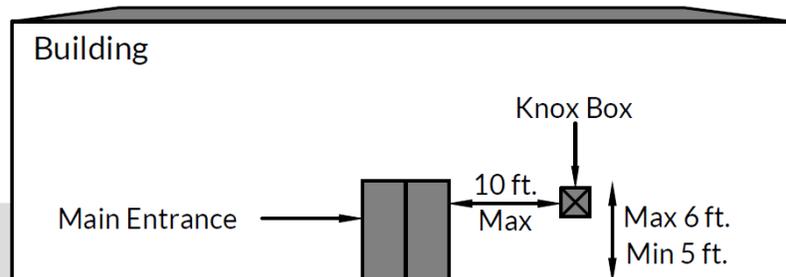

- Some buildings will require additional Knox devices.
- The “Fire Department” Alert Decal is to be mounted on the door or frame of the building’s main entrance.
- Keys to be placed into the Knox box will be determined by SFD Fire Prevention Staff (i.e. master key(s), Fire Riser Room, FACP, SDG&E, keys for appliance operation, etc.)
- Required keys shall be secured in Knox Box prior to final inspection/certificate of occupancy.
- Knox devices can be ordered and purchased at [www.knoxbox.com](http://www.knoxbox.com).
- Install per manufactures’ instructions.
- Minimum height = 5 ft. / Maximum height = 6 ft.